




RAMP SIDEWALK

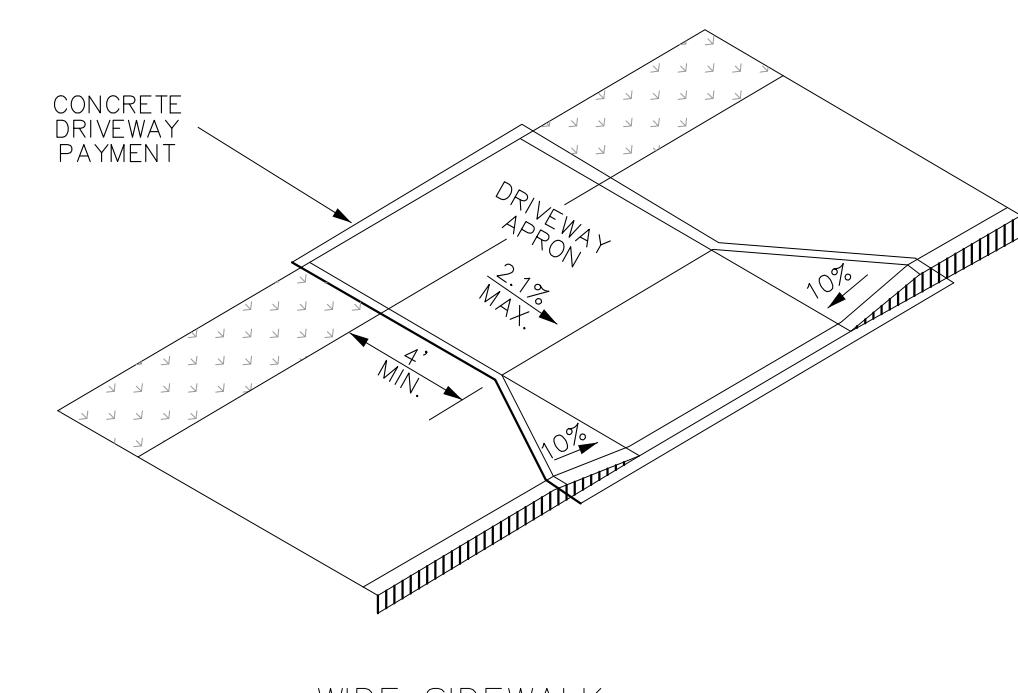


WIDE SIDEWALK

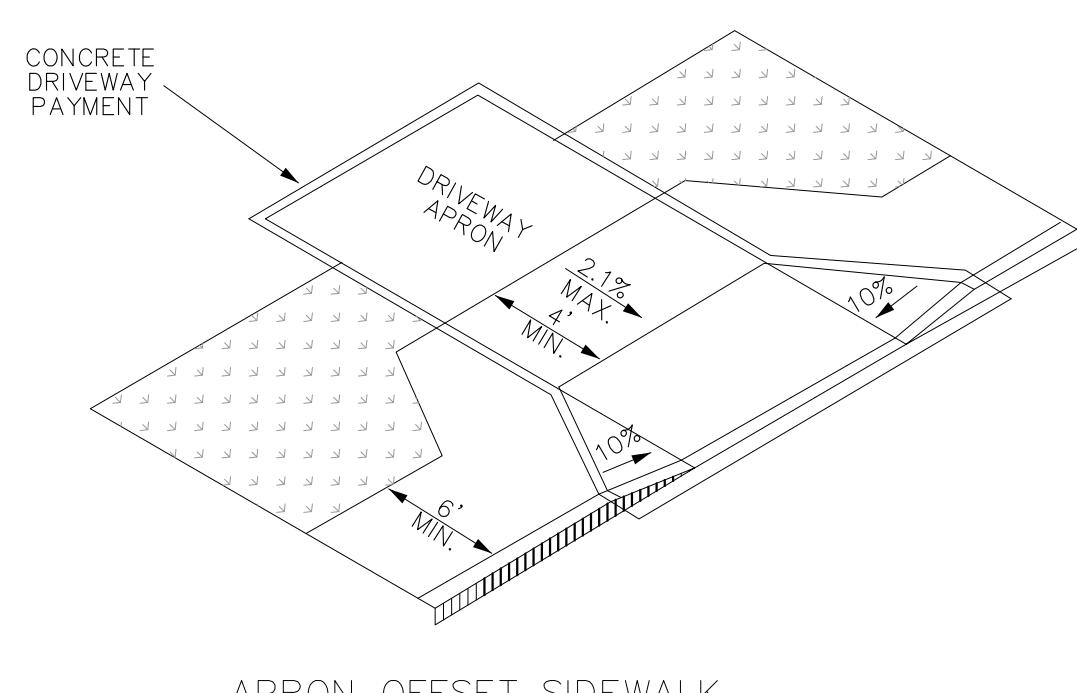


APRON OFFSET SIDEWALK

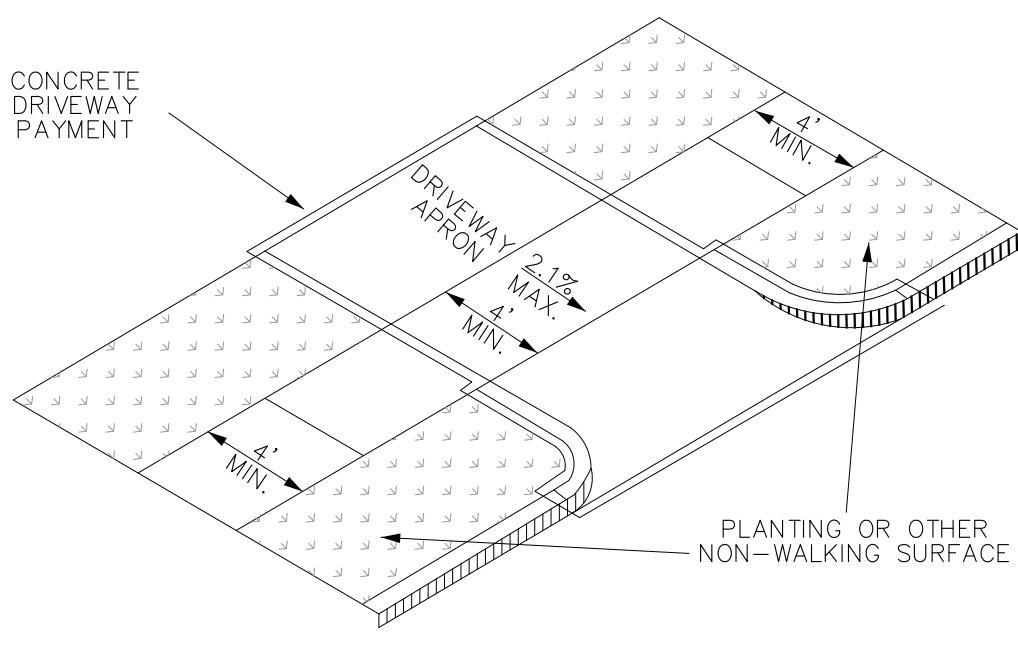


SIDEWALK TREATMENT AT DRIVEWAYS

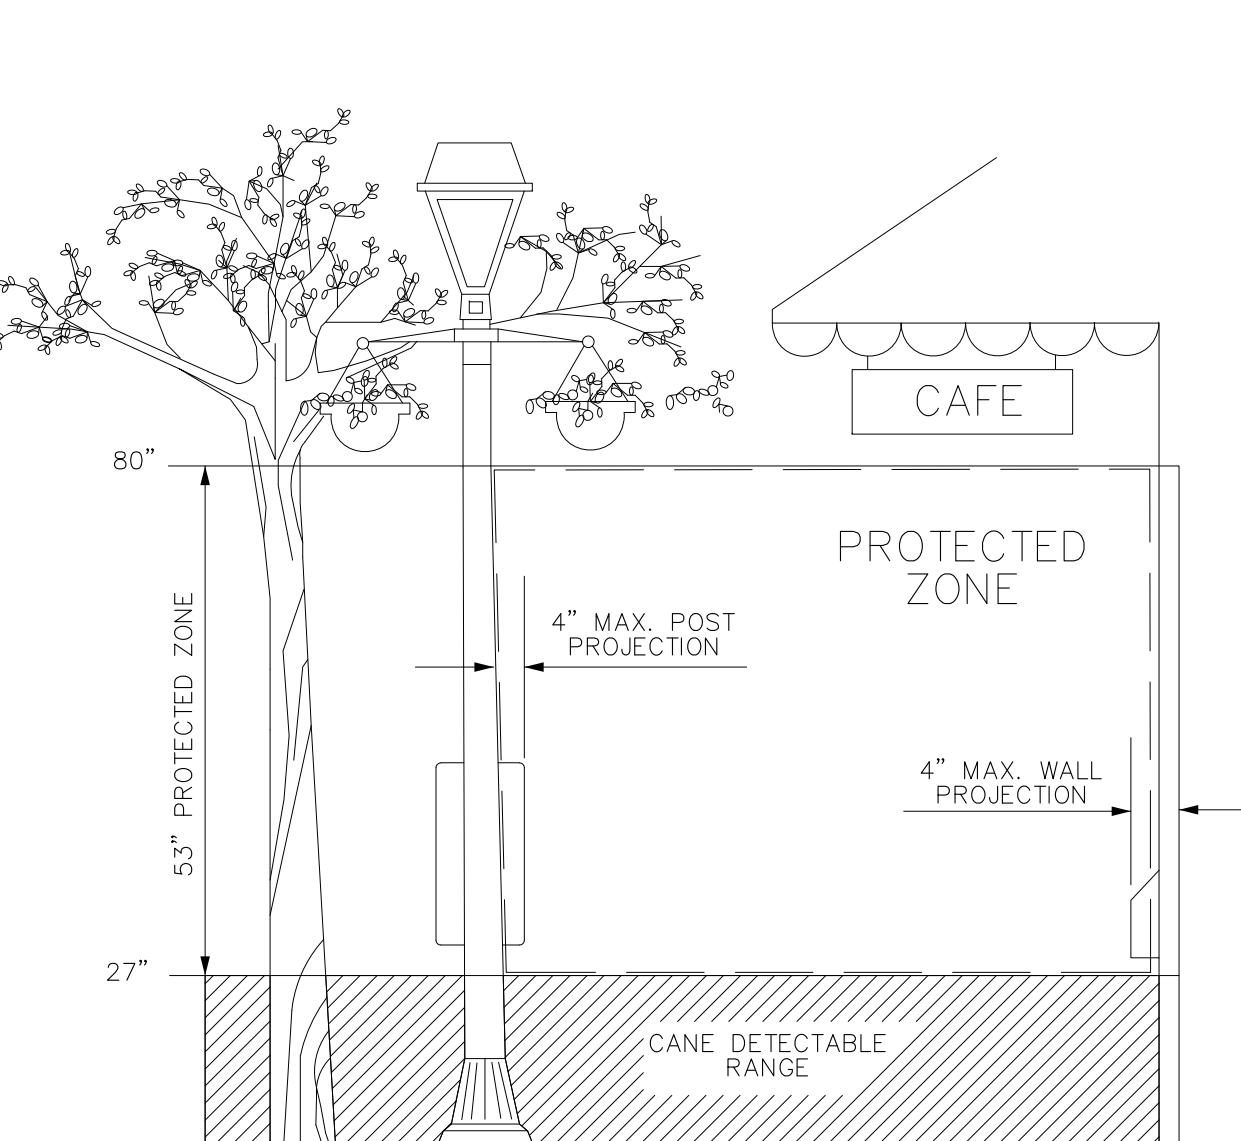

IAN CIRCULATION AREA, MAXIMUM 4" PROJECTION
OR WALL MOUNTED OBJECTS BETWEEN 27" AND 80"
ABOVE THE SURFACE

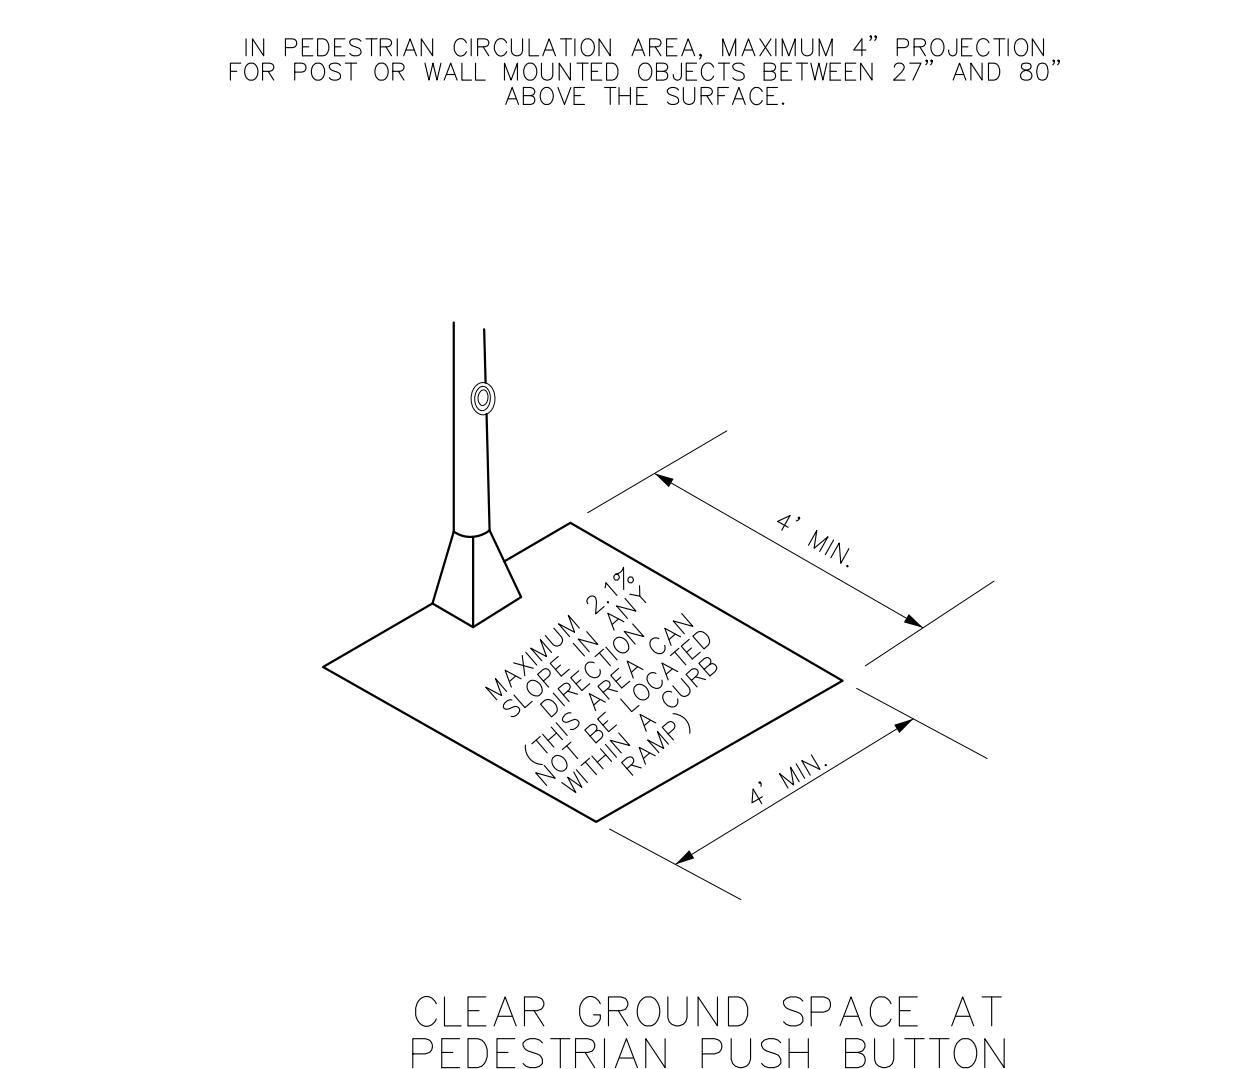

CLEAR GROUND SPACE AT PEDESTRIAN PUSH BUTTON

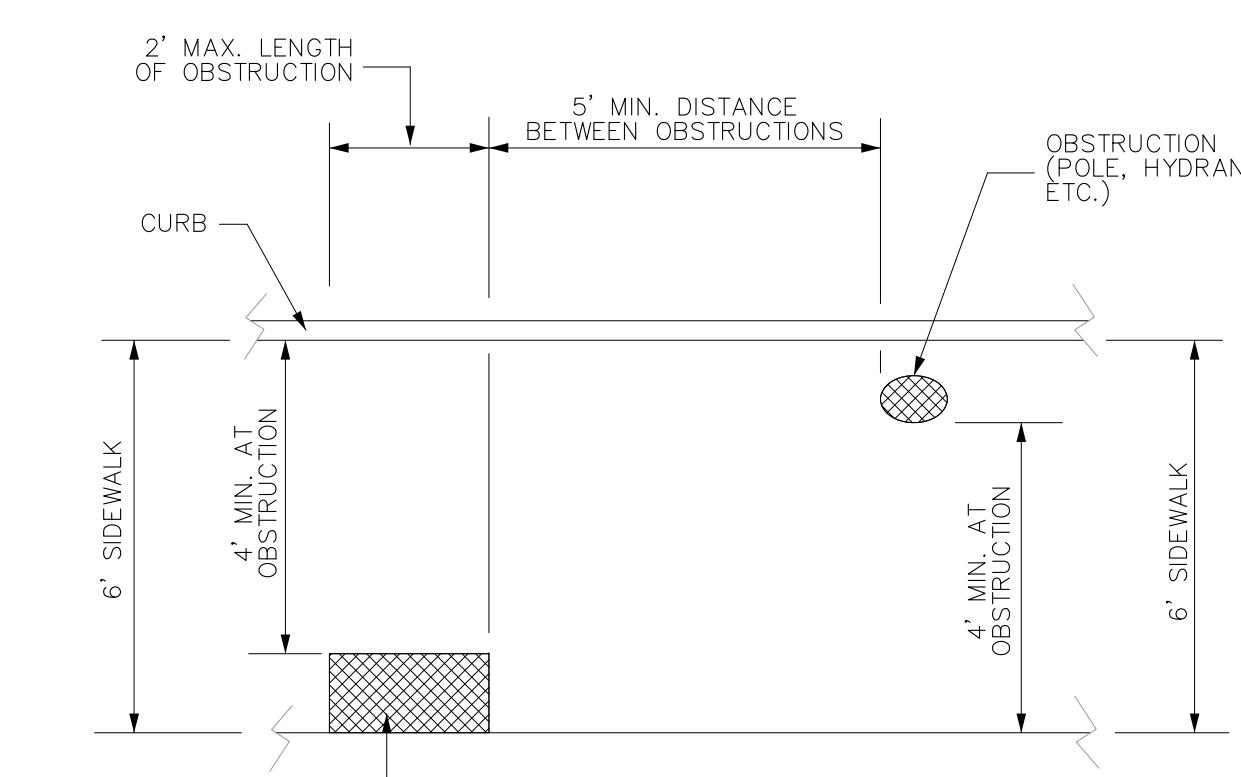


PLACEMENT OF STREET FIXTURE


(ITEMS NOT INTENDED FOR PUBLIC USE,
MINIMUM 4'x4' CLEAR GROUND SPACE
REQUIRED AT PUBLIC USE FIXTURES)

- ## PEDESTRIAN FACILITIES GENERAL NOTES:


1. ALL SLOPES SHOWN ARE MAXIMUM ALLOWABLE. THE LEAST POSSIBLE SLOPE THAT WILL DRAIN PROPERLY SHOULD BE USED.
 2. THE MINIMUM SIDEWALK WIDTH IS 4'. WHERE THE SIDEWALK IS ADJACENT TO THE BACK OF A BARRIER CURB, THE SIDEWALK WIDTH SHALL BE 6'. WHERE A 5' SIDEWALK IS NOT PROVIDED A 5'x5' PASSING AREA AT INTERVALS NOT TO EXCEED 200 FEET IS REQUIRED.
 3. CHANGES IN THE LEVEL OF SIDEWALK SHOULD BE NO MORE THAN $\frac{1}{4}$ ". CHANGES IN LEVEL GREATER THAN $\frac{1}{4}$ " BUT EQUAL TO OR LESS THAN $\frac{1}{2}$ " MAY BE BEVELED AT A 1:2 MAXIMUM SLOPE. A CHANGE IN LEVEL BETWEEN $\frac{1}{2}$ " AND 6" MAY BE SLOPED AT 1:12 MAXIMUM SLOPE. ANY CHANGE OF LEVEL GREATER THAN 6" SHALL REQUIRE A RAMP.
 4. THE MAXIMUM DESIRABLE SLOPE OF A CURB RAMP SHALL BE 7.1% (1:14). RAMP LENGTH OR GRADE OF APPROACH SIDEWALKS MAY BE ADJUSTED AS DIRECTED BY THE PROJECT ENGINEER.
 5. MANEUVERING SPACE AT THE BOTTOM OF PERPENDICULAR CURB RAMPS SHALL BE A MINIMUM OF 4'x4' WHOLLY CONTAINED WITHIN THE CROSSWALK AND WHOLLY OUTSIDE THE PARALLEL VEHICULAR TRAVEL PATH.
 6. FOR THE MAXIMUM ALLOWABLE CROSS SLOPE ON CROSSWALK, SIDEWALK, AND RAMP SURFACES SEE NOTES ON SHEET 1 OF PED-01.
 7. THE DESIRABLE LANDING DIMENSIONS ARE 5'x5' WITH A MAXIMUM 2.1% SLOPE, HOWEVER LANDING AND RAMP CROSS SLOPE CAN MATCH THAT OF THE CROSSWALK (SEE NOTES ON SHEET 1 OF PED-01 FOR MAXIMUM ALLOWABLE CROSS SLOPE). IF A LEVEL LANDING OF AT LEAST 4' WIDTH CANNOT BE PROVIDED, PERPENDICULAR CURB RAMPS SHOULD NOT BE USED.
 8. CURB RAMPS WITH RETURNED CURBS MAY ONLY BE USED WHERE PEDESTRIANS WOULD NOT NORMALLY WALK ACROSS THE RAMP. OTHERWISE, FLARED SIDES SHALL BE PROVIDED.
 9. ALL CONCRETE SURFACES SHALL RECEIVE A LIGHT BROOM FINISH UNLESS NOTED OTHERWISE IN THE PLANS.
 10. SEPARATE CURB RAMPS AND LANDINGS FROM ADJACENT SIDEWALK AND ANY OTHER ELEMENTS WITH PREMOLD OR BOARD JOINT OF 3/4" UNLESS OTHERWISE DIRECTED BY THE PROJECT ENGINEER.
 11. TOOLED JOINTS ARE REQUIRED AT ALL SIDEWALK RAMP OR DRIVEWAY SLOPE BREAK LINES.
 12. PROVIDE A SMOOTH TRANSITION WHERE THE CURB RAMPS CONNECT TO THE STREET AND THERE SHALL BE NO CHANGE IN LEVEL.
 13. RAMP TEXTURES MUST INCLUDE TRUNCATED DOMED SURFACES. TEXTURES ARE REQUIRED TO BE DETECTABLE UNDERFOOT. SURFACES THAT WOULD ALLOW WATER TO ACCUMULATE ARE PROHIBITED. SHADED AREAS INDICATE LOCATIONS OF DETECTABLE WARNINGS. (COLOR: LIGHT REFLECTIVE VALUE AND TEXTURE CONTRAST).
 14. NOTE THAT WHERE SIDEWALKS INTERSECT WITH STREETS, DETECTABLE WARNING SYSTEMS ARE REQUIRED AT ALL STREET CROSSINGS.
 15. RAMPS PROVIDING ACCESS TO BUILDINGS SHALL FOLLOW THE APPLICABLE REQUIREMENTS OF THE ADA ACCESSIBILITY GUIDELINES FOR BUILDINGS AND FACILITIES (ADAAG).
 16. TO SERVE AS A PEDESTRIAN REFUGE AREA, RAISED MEDIANES SHOULD BE A MINIMUM OF 6' WIDE. MEDIANES SHOULD BE DESIGNED TO PROVIDE ACCESSIBLE PASSAGE OVER OR THROUGH THEM.
 17. SMALL CHANNELIZATION ISLANDS, WHICH CANNOT PROVIDE A MINIMUM 5'x5' LANDING AT THE TOP OF RAMPS, SHALL BE CUT THROUGH LEVEL WITH THE SURFACE OF THE STREET.
 18. ON STREET PARKING WILL NOT BE ALLOWED WITHIN 20' OF ANY CROSSWALKS.
 19. DRAINAGE STRUCTURES IN CLOSE PROXIMITY TO CURB RAMPS SHOULD BE LOCATED ON THE UPSTREAM SIDE OF THE RAMP.
 20. TRAFFIC SIGNAL OR ILLUMINATION POLES, GROUND BOXES, CONTROLLER BOXES, SIGNS, DRAINAGE FACILITIES AND OTHER ITEMS SHALL BE PLACED SO AS NOT TO OBSTRUCT THE ACCESSIBLE ROUTE.
 21. STREET GRADES AND CROSS SLOPES SHALL BE AS SHOWN ELSEWHERE IN THE PLANS; HOWEVER, PARABOLIC CROWNS MAY REQUIRE ADJUSTMENT IN CROSSWALK AREAS TO LIMIT CROSSWALK GRADE TO 5%.
 22. WHERE EXISTING DRIVEWAY IS IN GOOD CONDITION AND MEETS SLOPE REQUIREMENTS, CONSTRUCT ONLY AS MUCH AS REQUIRED FOR SATISFACTORY CONNECTION WITH REQUIRED WORK.
 23. WHERE GRAVEL DRIVEWAYS OCCUR, AT LEAST 10' OF THE DRIVEWAY BEHIND THE SIDEWALK SHOULD BE SURFACED TO PREVENT TRACKING OF GRAVEL ONTO THE SIDEWALK.
 24. CROSSWALK DIMENSIONS AND CROSSWALK MARKINGS SHALL BE AS SHOWN ELSEWHERE IN THE PLANS. AT INTERSECTIONS WHERE CROSSWALK MARKINGS ARE NOT REQUIRED, RAMPS SHALL BE ALIGNED WITH THEORETICAL CROSSWALKS OR AS DIRECTED BY THE PROJECT ENGINEER.
 25. WHERE CROSSWALKS OCCUR, A 24" SOLID WHITE LINE SHALL BE PLACED ACROSS ALL APPROACH LANES TO INDICATE THE POINT BEHIND WHICH VEHICLES ARE TO STOP. STOP BARS SHALL BE PLACED 4' IN ADVANCE OF A CROSSWALK.
 26. DRIVEWAYS, SIDEWALKS, AND RAMPS SHALL BE CONSTRUCTED AND PAID FOR IN ACCORDANCE WITH THE APPLICABLE SECTIONS OF THE STANDARD SPECIFICATIONS. THE LIMITS OF PAYMENT FOR HANDICAP RAMPS SHALL INCLUDE BUT NOT BE LIMITED TO CURB TRANSITION, DETECTABLE WARNING SYSTEM, GUTTER, LANDING, AND BASE.
 27. THE RUNNING SLOPE OF SIDEWALKS IS 5% MAXIMUM. IF WITHIN THE PUBLIC RIGHT-OF-WAY, THE SIDEWALK MAY FOLLOW THE GRADE OF THE PARALLEL ROADWAY WITHOUT INVOKING VARIANCES, LANDINGS, OR HANDRAILS. WHERE A CONTINUOUS GRADE GREATER THAN 5% MUST BE PROVIDED, HANDRAILS MAY BE DESIRABLE ON ONE OR BOTH SIDES OF THE SIDEWALK TO IMPROVE ACCESSIBILITY.
 28. ALL RAMPS SHALL HAVE GRAD BREAKS PERPENDICULAR TO THE RAMP SLOPE.
 29. SHOULD AN EXISTING SIDEWALK NEED TO BE CLOSED FOR ANY REASON, OR FOR ANY PERIOD OF TIME, PEDESTRIANS SHALL BE DIRECTED TO A DETOUR ROUTE. BOTH VISUAL AND AUDIBLE SIGNAGE SHALL BE PROVIDED IN ADVANCE OF PEDESTRIAN DECISION POINTS. THE DETOUR ROUTE SHALL HAVE EQUAL OR GREATER ACCESSIBILITY THAN THE EXISTING SIDEWALK IN TERMS OF SLOPES, SURFACE CONDITION, MATERIAL, AND WIDTH.

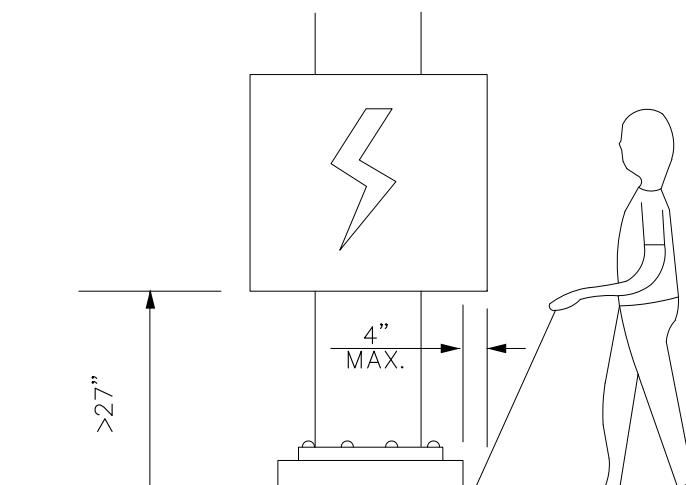

WHEN AN OBSTRUCTION OF A HEIGHT GREATER THAN 24" FROM THE SURFACE WOULD CREATE A PROTRUSION OF MORE THAN 4" INTO THE PEDESTRIAN CIRCULATION AREA CONSTRUCTION ADDITIONAL CURB OR FOUNDATION AT THE BOTTOM TO PROVIDE A MAXIMUM 4" OVERHANG.

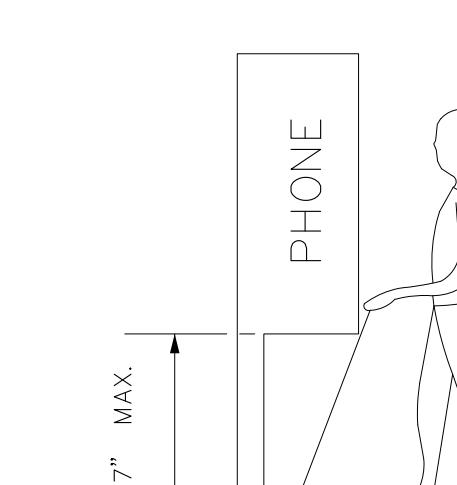

PROTRUDING OBJECTS OF A HEIGHT
LESS THAN OR EQUAL TO 27"
DETECTABLE BY CANE AND DO
NOT REQUIRE ADDITIONAL TREATMENT

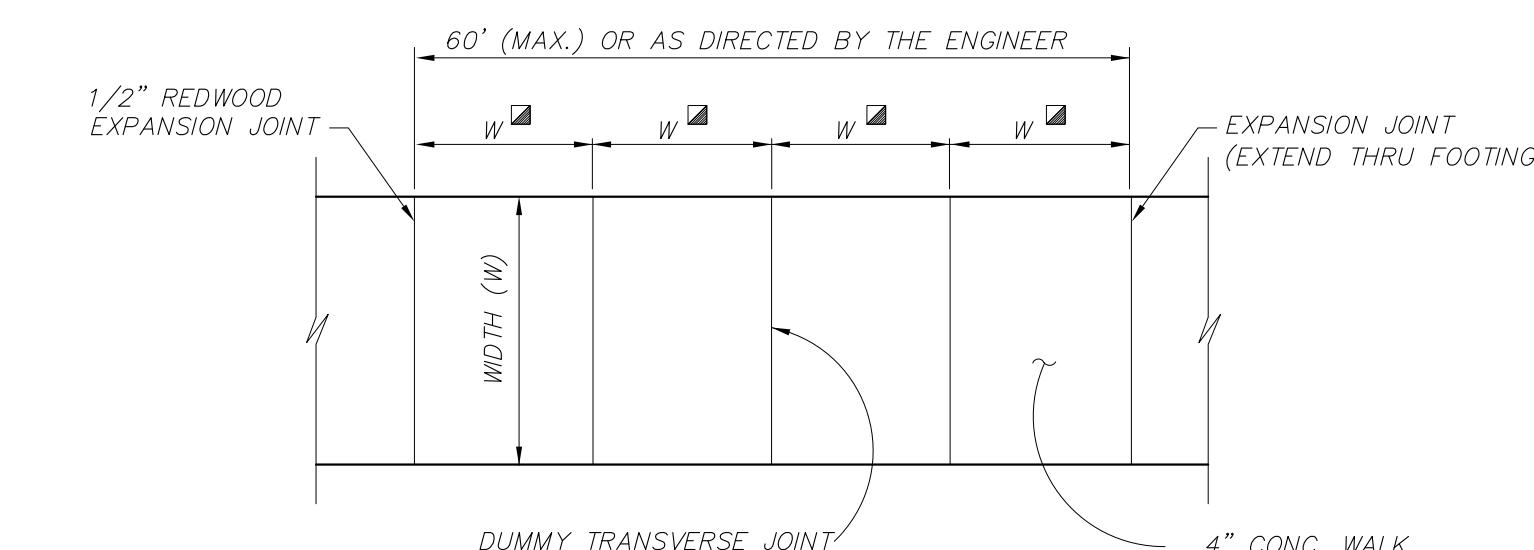

SIDEWALK DETAIL

- ☒ SPACING OF DUMMY TRANSVERSE JOINTS ON CONCRETE WALKS SHALL BE EQUAL TO THE WIDTH OF THE WALK BUT NOT GREATER THAN 10 FEET

EXPANSION JOINTS SHALL BE PLACED AT CHANGES IN GRADE AND AT OBSTRUCTIONS.